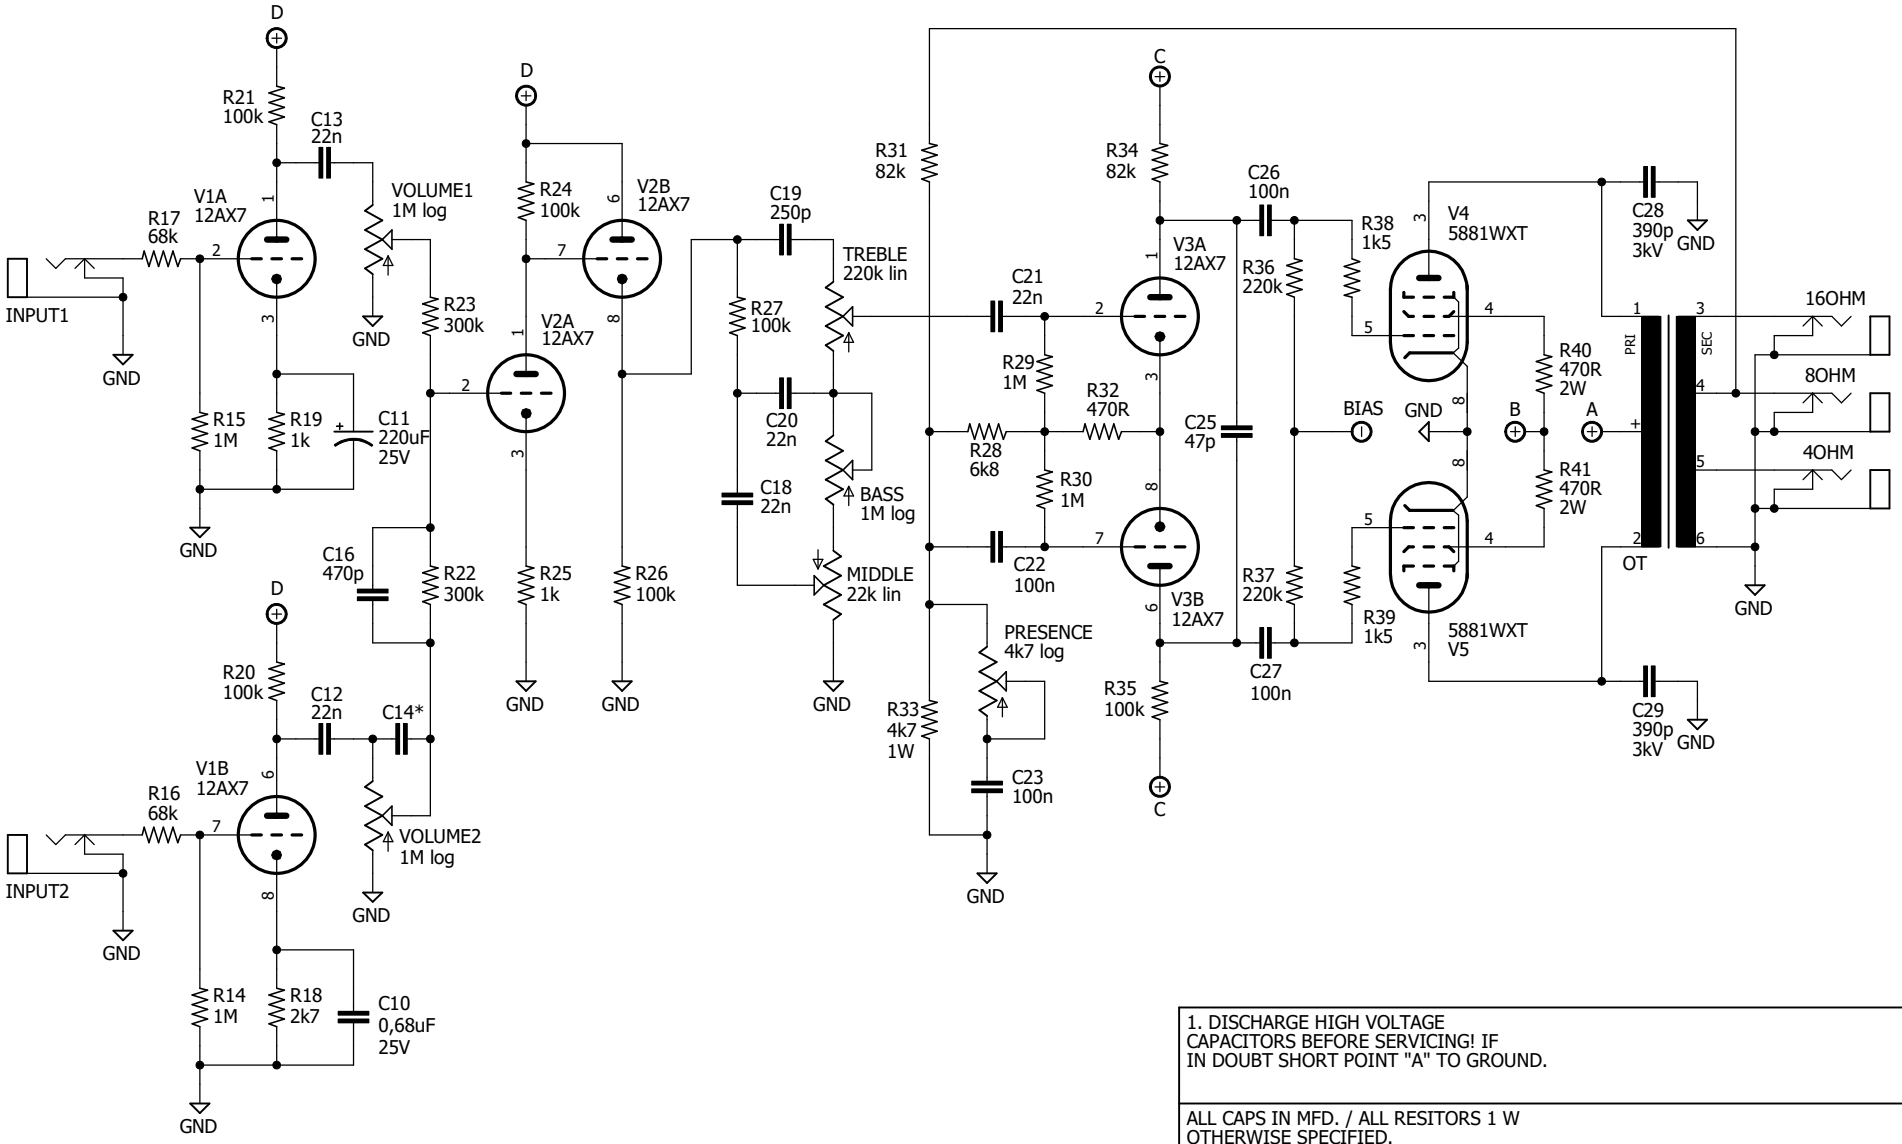


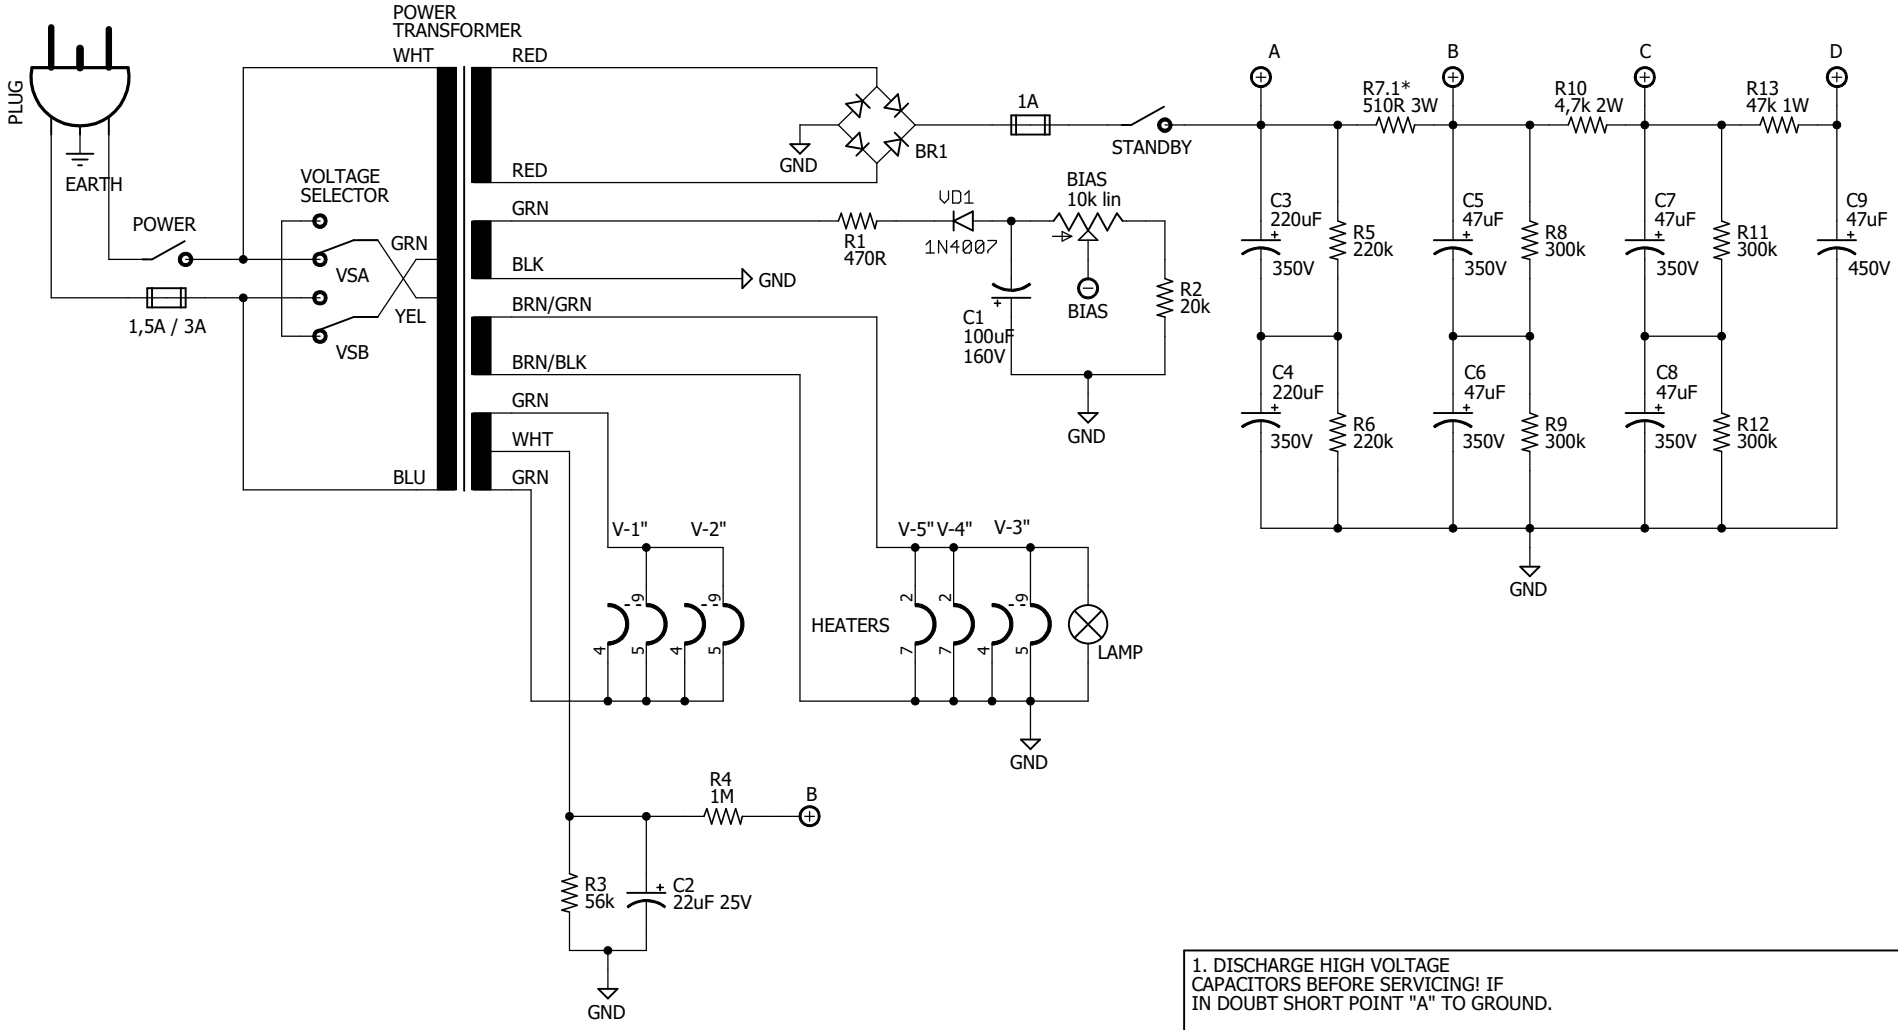

1. DISCHARGE HIGH VOLTAGE CAPACITORS BEFORE SERVICING! IF IN DOUBT SHORT POINT "A" TO GROUND.

ALL CAPS IN MFD. / ALL RESITORS 1 W OTHERWISE SPECIFIED.

Title: Sovtek Mig 50

Date: 14.01.2009 14:23

Sheet: 1/2




1. DISCHARGE HIGH VOLTAGE CAPACITORS BEFORE SERVICING! IF IN DOUBT SHORT POINT "A" TO GROUND.

ALL CAPS IN MFD. / ALL RESITORS 1 W OTHERWISE SPECIFIED.

Title: Sovtek Mig 50

Date: 14.01.2009 14:23

Sheet: 2/2