
REVISIONS			
REV.	DESCRIPTION	DATE	APPROVED
A	PR 497	09-MAY-03	dBL

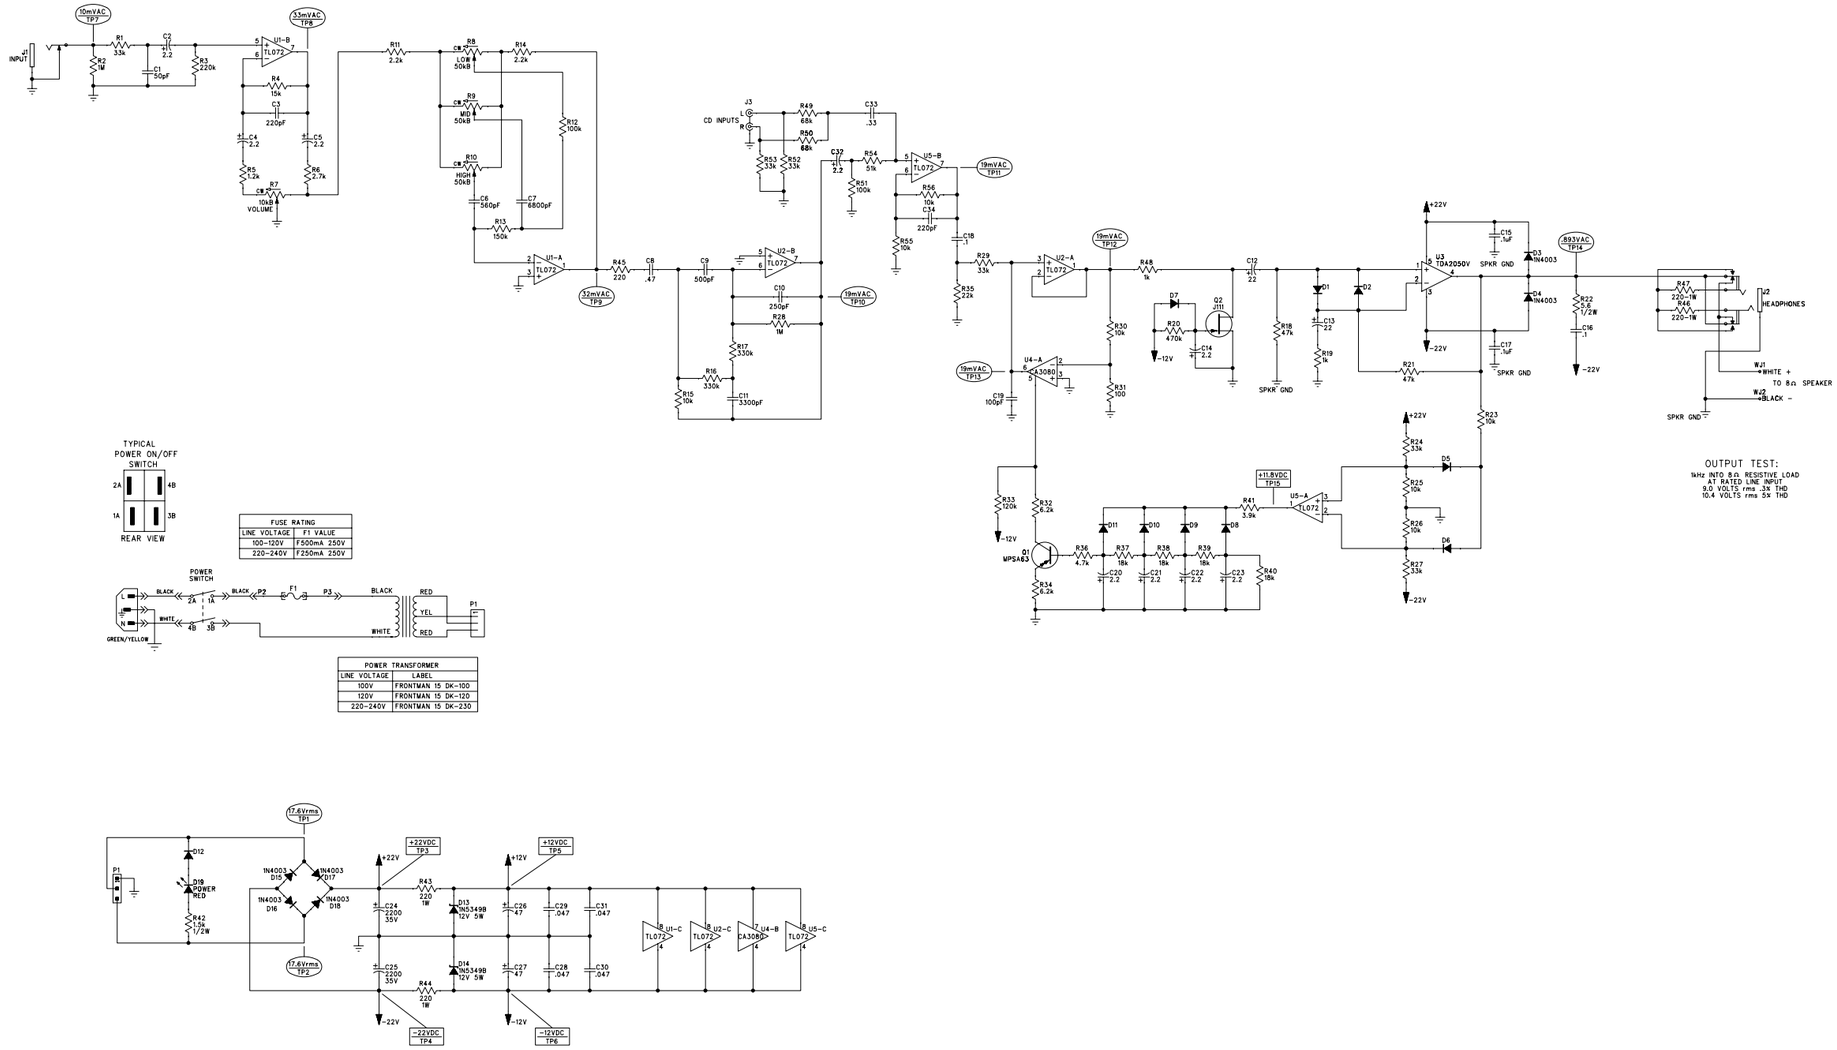

7. LAST REFERENCE DESIGNATORS: C34, D19, F1, J3, P3, Q2, R56, TP15, U5, W2.
6. AC AND DC VOLTAGES READ TO GROUND WITH A DVM UNDER THE FOLLOWING CONDITIONS:
   UNIT AT RATED LINE VOLTAGE
   8Ω RESISTIVE LOAD CONNECTED AT W1-W2
   NO INPUT SIGNAL (TP1-6, TP15)
   VOLTAGES MAY VARY +/- 20%
   ALL CONTROLS SET TO 12 O'CLOCK (50% ROTATION)
   10mV, 1kHz SINEWAVE INPUT SIGNAL AT J1
5. THIS SCHEMATIC IS FOR PCB FABRICATION P/N 0063691000 AND PCB ASSEMBLY P/N 0063690000.
4. ALL DIODES ARE IN4448.
3. ALL POLARIZED CAPACITORS IN uF, 20%; 50V MINIMUM.
2. ALL UNPOLARIZED CAPACITORS IN uF; 10% OR BETTER; 50V MINIMUM. (POWER SUPPLY BYPASS CAPACITORS ARE 20%).
1. ALL RESISTORS IN OHMS, 5%; 1/4W.

NOTES: (UNLESS OTHERWISE NOTED)

THIS DOCUMENT CONTAINS INFORMATION OF A PROPRIETARY NATURE TO FENDER MUSICAL INSTRUMENTS AND IS SUBMITTED TO YOU IN CONFIDENCE AND SHALL NOT BE DISCLOSED OR TRANSMITTED TO OTHERS WITHOUT AUTHORIZATION FROM FENDER MUSICAL INSTRUMENTS.

CHECKED BY: _____ DATE: _____
APPROVED BY: _____ DATE: _____
DRAWN: D. LEWIS ENGR: D. LEWIS
DATABASE FILE: Z497S.SCH

Fender MUSICAL INSTRUMENTS
Corona, CA U.S.A.

TITLE: SERVICE DIAGRAM, COMBINED (schematic)
RUMBLE 15
BASS AMPLIFIER

SIZE	DRAWING NUMBER	REV.
D	0063692000	A

RELEASE DATE: 09-MAY-03 SHEET: 1 OF 1