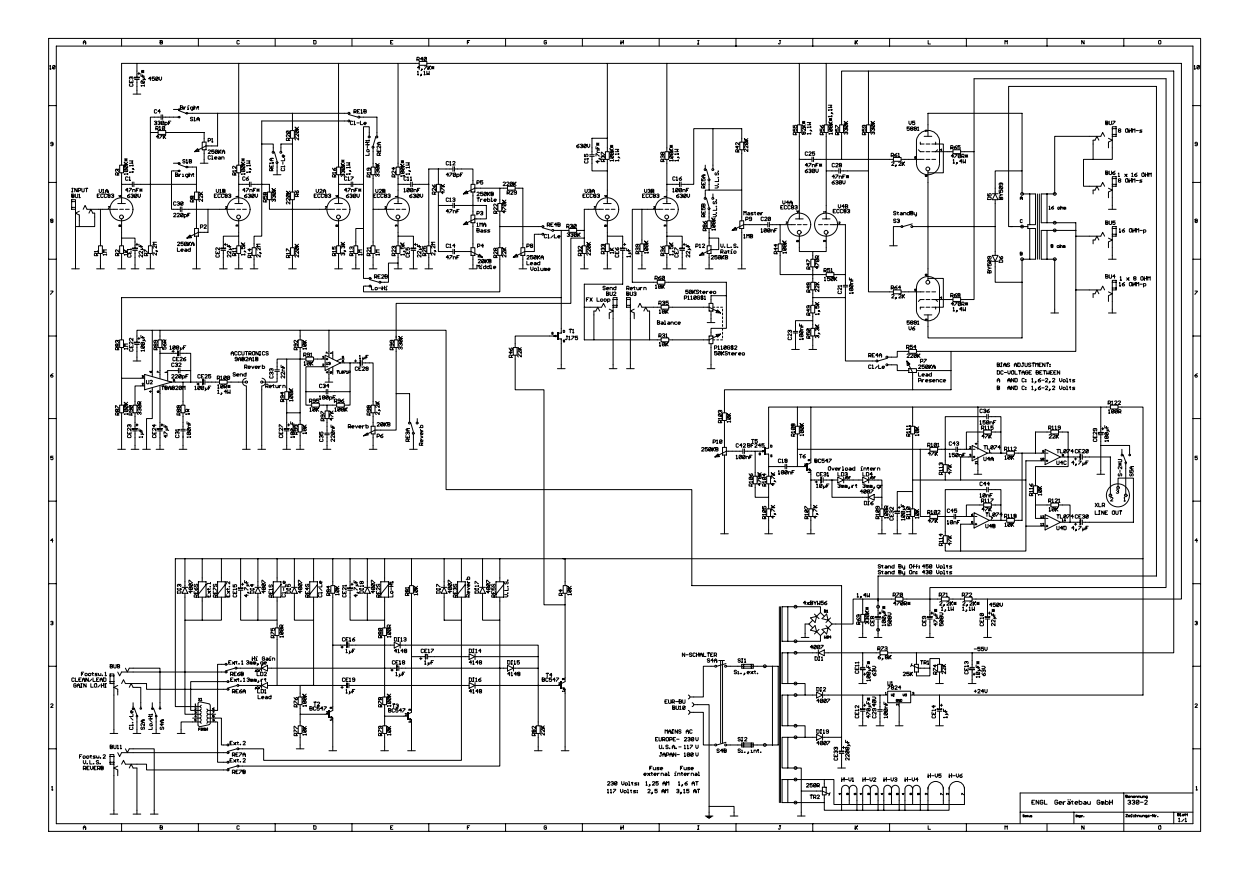

INPUT
Bright
Clean
Lead
Treble
Bass
Middle
Lead Volume
Send
Return
FX Loop
Balance
Reverb
Tune
Overload intern
Lead Presence
Standby
Master
Volume
Presence
BIAS ADJUSTMENT:
DC-VOLTAGE BETWEEN
A AND C: 1,6-2,2 Volts
B AND C: 1,6-2,2 Volts
LINE OUT
Stand By DHH 458 Volts
Stand By DH 438 Volts
Fuse
external
Internal
230 Volts: 1,25 AT 1,6 AT
117 Volts: 2,5 AT 3,15 AT
ENGL Gerätebau GmbH
Bezeichnung
338-2
Datum
Name
Zeichnungs-Nr.
Blatt
1/1